


Carmichael Water District Water Treatment Plant Inspection and District Office Evacuation Drill

The pipes running across the floor in the pump room were re-routed eliminating a tripping hazard and drains were cleared to ensure proper drainage to keep the floor dry eliminating a slipping hazard.



Signage was added and clearance will be maintained for all fire extinguishers.

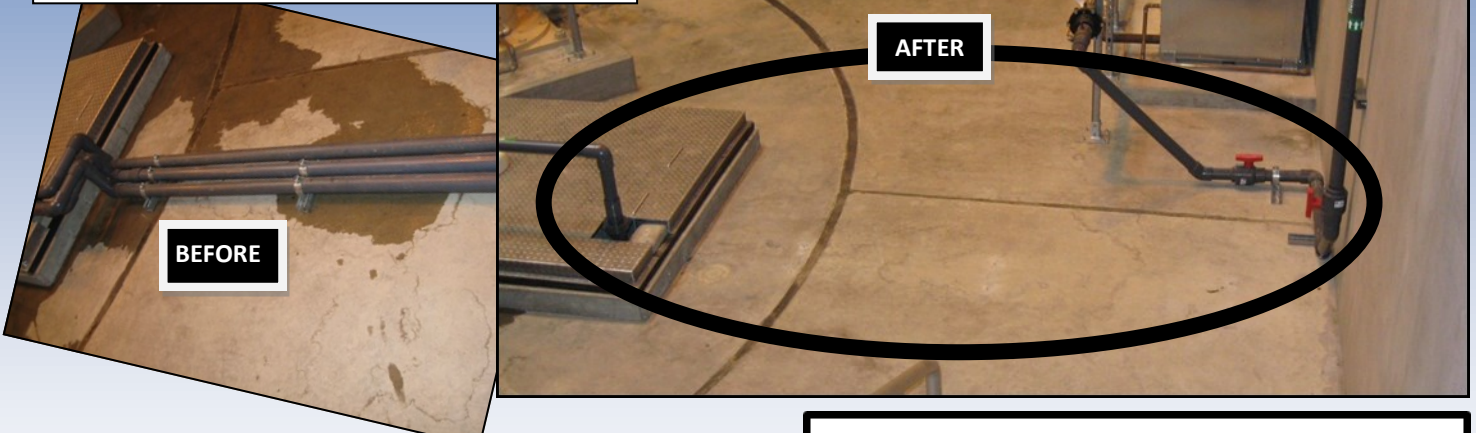

Chris Nelson takes on the role of Incident Commander during the fire evacuation drill. A discussion was also held at that time to determine what went well and ideas were brainstormed as to what could be done differently in the future to ensure the safety of both employees and the public in an emergency.



Labeling was applied to the emergency disinfection tank, all PLC cabinets and remaining unlabeled pipes.

